

## Through-penetration Firestop Systems

System No. W-L-5284


June 24, 2008

**F Rating — 1 and 2 Hr (See Item 1B)**

**T Rating — 1/2 Hr**

**L Rating at Ambient - Less than 1 CFM/sq ft**

**L Rating at 400° F - Less than 1 CFM/sq ft**

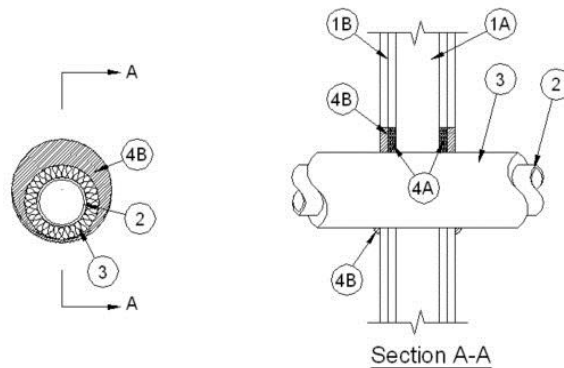

**1. Wall Assembly** — The 1 or 2 hr fire-rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner described in the individual U300, U400 or V400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

**A. Studs Wall** — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC with nom 2 by 4 in. (51 by 102 mm) lumber end plates and cross braces. Steel studs to be min 3-5/8 in. (92 mm) wide and spaced max 24 in. (610 mm) OC.

**B. Gypsum Board\*** — Min 5/8 in. (16 mm) thick, 4 ft (1.2 m) wide with square or tapered edges. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U300, U400 or V400 Series Designs in the UL Fire Resistance Directory. Max diam of opening in wood stud walls is 14-1/2 in. (368 mm) Max diam of opening in steel stud walls is 18-3/4 in. (476 mm).

**The hourly F Rating of the firestop system is equal to the hourly fire rating of the wall assembly in which it is installed.**

**2. Through Penetrants** — One metallic pipe or tubing to be installed either concentrically or eccentrically within the firestop system. Pipe or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes or tubing may be used:

**A. Steel Pipe** — Nom 12 in. (305 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.

**B. Iron Pipe** — Nom 12 in. (305 mm) diam (or smaller) cast or ductile iron pipe.

**C. Copper Tubing** — Nom 6 in. (152 mm) diam (or smaller) Type L (or heavier) copper tubing.

**D. Copper Pipe** — Nom 6 in. (152 mm) diam (or smaller) Regular (or heavier) copper pipe.

The max diam of the through penetrant is dependent upon the type of fill material used, as shown in Item 4B.

3. **Tube Insulation** — - **Plastics**<sup>+</sup> — Nom 3/4 in. (19 mm) thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing. The annular space between the insulated through penetrant and the periphery of the opening shall be a min of 0 in. ( 0 mm, point contact) to a max 1 in. (25 mm).

See **Plastics**<sup>+</sup> (**QMFZ2**) category in the Plastics Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL94 Flammability Classification of 94-5VA may be used.

4. **Firestop System** — The firestop system shall consist of the following:

A. **Packing Material** — Forms used to prevent leakage of fill material during installation in 2 hr fire-rated wall assemblies. Forms to be rigid sheet or polyurethane backer rod, cut to fit the contour of the penetrating item and friction fitted into opening on both sides of wall. Forms to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material.

B. **Fill, Void or Cavity Materials\* - Sealant** — Min 5/8 in. (19 mm) thickness of fill material applied within the annulus, flush with both surfaces of wall. At the point contact location between insulated through penetrant and gypsum board, a min 3/8 in. (10 mm) diam bead of fill material shall be applied at the gypsum board/insulated through penetrant interface on both surfaces of wall.

**ACCUMETRIC L L C** — Boss 816

\*Bearing the UL Classification Mark

+Bearing the UL Recognized Component Mark